

DELUGE VALVE

MODEL: SD-DVH3

TECHNICAL SPECIFICATION

Normal Size	200, 150, 100, 80, 50 NB	
Material	Ductile Iron ASTM A536-77 Grade 65-45-12	
Service Pressure	1.4 to 17.5 Bar (20 to 250 PSI)	
Threaded Opening	BSPT	
Mounting	Vertical or Horizontal	
Factory Hydrostatic Test Pressure	35 Kg/sq.cm. (500 PSI)	
Flange Connection	ANSI B 16.5 # 150 FF (RF-Optional)	
Wet Pilot Sprinkler	As per graph in the catalogue	
Net Weight without Trim	F x F	G x G
	200 NB - 153 Kg	143Kg
	150 NB - 79 Kg	68Kg
	100 NB - 50 Kg	42Kg
	80 NB - 35 Kg	29Kg
	50 NB - 32 Kg	27Kg
FINISH	RAL 3000	
Ordering Information	1. Size of Valve 2. Flange specification 3. Valve trim vertical or horizontal 4. Trim type	
End Connection	Flange x Flange Groove x Groove	

DESCRIPTION

Deluge Valve is known as a system control valve in a deluge system, used for fast application of water in a spray system. Deluge valve protects areas such as power transformer installation, storage tank, conveyor protection and other industrial application etc. With the addition of foaming agent deluge valve can be used to protect aircraft hanger and inflammable liquid fire.

VALVE OPERATION

SHIELD Deluge valve is a quick release, hydraulically operated diaphragm valve. It has three chambers, isolated from each other by the diaphragm operated clapper and seat seal. While in SET position, water pressure is transmitted through an external bypass check valve and restriction orifice from the system supply side to the top chamber, so that supply pressure in the top chamber act across the diaphragm operated clapper which holds the seat against the inlet supply pressure because of the differential pressure design.



NOMINAL SIZE	Pipe OD in MM
2" (50 NB)	60.3
3" (80 NB)	89.0
4" (100 NB)	114.3
6" (150 NB)	165.1
6" (150 NB)	168.3
8" (200 NB)	219.1

Note: For 6"(150nb) standard supply is 168.3 mm Od pipe groove. For 165.1mm specify in order

On detection of fire the top chamber is vented to atmosphere through the outlet port via opened actuation devices. The top chamber pressure cannot be replenished through the restricted inlet port, and the upward force of the supply pressure lifts the clapper allowing the water flow to the system piping network and alarm devices.

TRIM DESCRIPTION

The trims are functionally termed as Dry Pilot Trim, Wet Pilot Trim, Electric Trim and Test and Alarm Trim as per the method of actuation of the deluge valve.

The functionality of these trims is described below.

a) DRY PILOT TRIM (PNEUMATIC RELEASE)

Dry pilot operation uses a pilot line of closed Sprinkles/ QB detectors containing air under pressure, located in the area to be protected. It requires regulated dry air supply with main supply point through restricted orifice. The air pressure to be maintained as specified in the catalogue of Dry Pilot Actuator. The pilot line is connected to air inlet side of actuator. The top chamber of the deluge valve is connected to water inlet side of actuator.

When there is an air pressure drop, or due to release of any of the release device on detection of fire, the diaphragm of actuator is lifted and allows the water to drain. This releases the water pressure in the top chamber of the deluge valve, allowing the deluge valve to open and water to flow into the system piping & alarm devices. Recommended air supply pressure for dry pilot trim system is 3.5 kg/sq.cm.

User must install non return valve at air supply connection to deluge valve trim.

b) WET PILOT TRIM (HYDRAULIC RELEASE)

Wet pilot operation uses a pilot line of closed Sprinklers/ QB detectors containing pressurized water, supplied through the upstream side of the Deluge valve, through a restricted orifice. All the release lines are connected

to a common release line. Due to release of any one of the release device, the water pressure in the top chamber of the Deluge valve drops and the Deluge valve opens.

c) ELECTRIC RELEASE TRIM

To actuate a Deluge valve electrically, a solenoid valve is provided to drain the water from the top chamber of the Deluge valve. A pressure switch is provided to activate an electric alarm, to shut down the desired equipment or to give "Tripped" indication of the Deluge valve. In addition to this a pressure switch can also monitor "Low air pressure" and "Fire condition" when used in dry pilot air line.

d) TEST AND ALARM TRIM

This trim is supplied with a test valve is provided to test the normal operation of the sprinkler alarm bell. The sprinkler alarm can be supplied additionally, which bells on actuation of the Deluge valve.

e) DRAIN AND DRIP TRIM

This consists of main and system drain valve in addition with drip valve.

TRIM TYPES

The trims are designated as following.

W =Wet Pilot trim. D = Dry Pilot Trim

TRIM MODEL NO.	TRIM DESCRIPTION	MOUNTING	SCHEMATIC NO.
SH3-TW	Basic Wet Pilot Trim	Vertical	Schematic 1
SH3-TD	Basic Dry Pilot Trim	Vertical	Schematic 2
SH3-TWT	Basic Wet Pilot Trim with Test and Alarm Trim	Vertical	Schematic 3
SH3-TDT	Basic Dry Pilot Trim with Test and Alarm Trim	Vertical	Schematic 4
SH3-TWD	Basic Wet Pilot Trim with Drip and Drain Trim	Vertical	Schematic 5
SH3-TDD	Basic Dry Pilot Trim with Drip and Drain Trim	Vertical	Schematic 6
SH3-NTW	Basic Wet Pilot Trim with Test and Alarm Trim & Drip and Drain Trim	Vertical	Schematic 7
SH3-NTD	Basic Dry Pilot Trim with Test and Alarm Trim & Drip and Drain Trim	Vertical	Schematic 8
SH3-TW	Basic Wet Pilot Trim	Horizontal	Schematic 9
SH3-TD	Basic Dry Pilot Trim	Horizontal	Schematic 10
SH3-TWT	Basic Wet Pilot Trim with Test and Alarm Trim	Horizontal	Schematic 11
SH3-TDT	Basic Dry Pilot Trim with Test and Alarm Trim	Horizontal	Schematic 12
SH3-TWD	Basic Wet Pilot Trim with Drip and Drain Trim	Horizontal	Schematic 13
SH3-TDD	Basic Dry Pilot Trim with Drip and Drain Trim	Horizontal	Schematic 14
SH3-NTW	Basic Wet Pilot Trim with Test and Alarm Trim & Drip and Drain Trim	Horizontal	Schematic 15
SH3-NTD	Basic Dry Pilot Trim with Test and Alarm Trim & Drip and Drain Trim	Horizontal	Schematic 16

a) Type SH3-TW and SH3-TD

This type of trim is basic trim required to operate the deluge valve. A solenoid valve for electric remote actuation and pressure switch for sensing & annunciation are optional.

b) Type SH3-TWD and SH3-TDD

This trim type is a combination of components of normal trim along with the drip and drain trim. A solenoid valve for electric remote actuation and pressure switch for sensing & annunciation are optional.

c) Type SH3-TWT and SH3-TDT

This trim type is a combination of components of normal trim along with the test and alarm trim. In dry pilot trim, an actuator is provided. A solenoid valve for electric remote actuation and pressure switch for sensing & annunciation are optional.

d) Type SH3-NTW and SH3-NTD

This trim type is a combination of components of normal trim along with the test and alarm trim as well as the drip and drain trim. A solenoid valve for electric remote actuation and pressure switch for sensing & annunciation are optional.

RESETTING PROCEDURE FOR THE DELUGE VALVE

1. Close the upstream side stop valve provided below the deluge valve
2. Open both the drain valves/ drain plugs and close when the flow of water has ceased
3. Close the release device/replace the Sprinkler if release was through Sprinkler/QB Detector
4. Inspect and release if required, or close the section of the detection system subjected to "Fire condition"
5. In case of dry pilot detection system, open the air supply valve to build-up air pressure. Open the priming valve fully. Open the upstream side of the stop valve provided below the Deluge valve. No water should flow into the system.
6. Where priming shut off valve is provided for resetting, in addition to above steps press the knob on actuator while resetting

CAUTION

- Do not close the priming valve, downstream and upstream stop valves, while the system is in service.
- The releasing device must be maintained in the open position, when actuated, to prevent the deluge valve from closure if anti shut off valve is not provided.
- While using a Deluge valve in the wet pilot system the height and the length of the wet pilot detection line is to be limited as shown in the wet pilot sprinkler height limitation graph.

- Do not connect the Sprinkler Alarm outlet drain line to close a common drain as it may create back pressure and Sprinkler Alarm may not function.
- Deluge valve must have support to absorb sudden opening or closing vibration shock to the piping.
- To avoid water damage, take precautions when opening the water supply main control valve, since water will flow from all open system valves.
- The responsibility of maintenance of the protection system and devices in proper operating condition lies with the owner of the system.

SYSTEM TESTING PROCEDURE

1. Keep the upstream side of the stop valve partially open. To avoid water flow to system side close the system side stop valve. This valve is to be kept in open position after the testing is completed.
2. Let any of the release devices to trip. This will result in a sudden drop of water pressure in the deluge valve top chamber which in turn will open the deluge valve. Close the upstream side stop valve immediately.
3. Reset the valve as per the procedure given under heading "RESETTING PROCEDURE FOR THE DELUGE VALVE"

INSPECTION AND MAINTENANCE

Installed system piping network must be flushed properly before placing the Deluge valve in service.

A qualified and trained person must commission the system. After few initial successful tests, an authorized person must be trained to perform inspection and testing of the system. It is recommended to have regular inspection and test run of the system as per NFPA guideline or in accordance to the organisation having local jurisdiction.

(i) WARNING

Inspection and testing is to be carried out only by authorised and trained personnel. DO NOT TURN OFF the water supply or close any valve to make repair(s) or test the valve, without placing a roving fire patrol in the area covered by the system. Also inform the local security personnel and central alarm station, so that there is no false alarm signal.

It is recommended to carry out physical inspection of the system at least twice in a week. The inspection should verify that all the control valves are in proper position as per the system requirement and that there are no damages to any component.

The frequency of inspections must be increased in the presence of contaminated water supplies, corrosive/ scaling water supplies, and corrosive atmospheres.

(ii) NORMAL CONDITION

- All main valves are open and are sealed with tamper proof seal
- Drain valves must be kept closed
- No leak or drip is detected from the drip valve
- All the gauges except the system side water pressure gauge, should show the required pressure
- There should be no leakage in the system

(iii) NORMAL CONDITION TEST

- The system should be checked for normal condition at least once in a week
- Test the sprinkler alarm bell or electric alarm by turning the alarm test valve to the test position. The alarm should sound. This test should be carried out at least once in a week
- Depress the drip valve knob. Significant accumulation indicates a possible seat leakage
- Conduct the water flow test as per the procedure of system testing at least once a month

(iv) PERIODIC CHECK

Conduct the water flow test by actuating few of the release devices provided in the system. Clean all strainer(s) and priming line restriction. This test is to be carried out at least once in three months.

ABNORMAL CONDITION**(i) ALARM FAILS TO SOUND**

- Check for any obstruction in the alarm test line, make certain that the sprinkler alarm is free to operate
- If an electric alarm is provided, check the electrical circuitry to the alarm


(ii) FALSE TRIPS

- Check for clogging in priming line, restriction orifice check valve, priming valve & strainer
- Leakage in the release system
- The deluge air panel orifice clogged or low supply pressure

(iii) LEAKAGE THROUGH THE DELUGE VALVE

- Damaged deluge valve seat or obstruction on the seat face by foreign object
- Leakage in release system
- Partly clogged priming line restriction orifice check valve
- Low air pressure on release system line or leakage in release system


DELUGE VALVE MODEL - H3 SIZE 200 / 150 / 100 / 80/ 50 NB

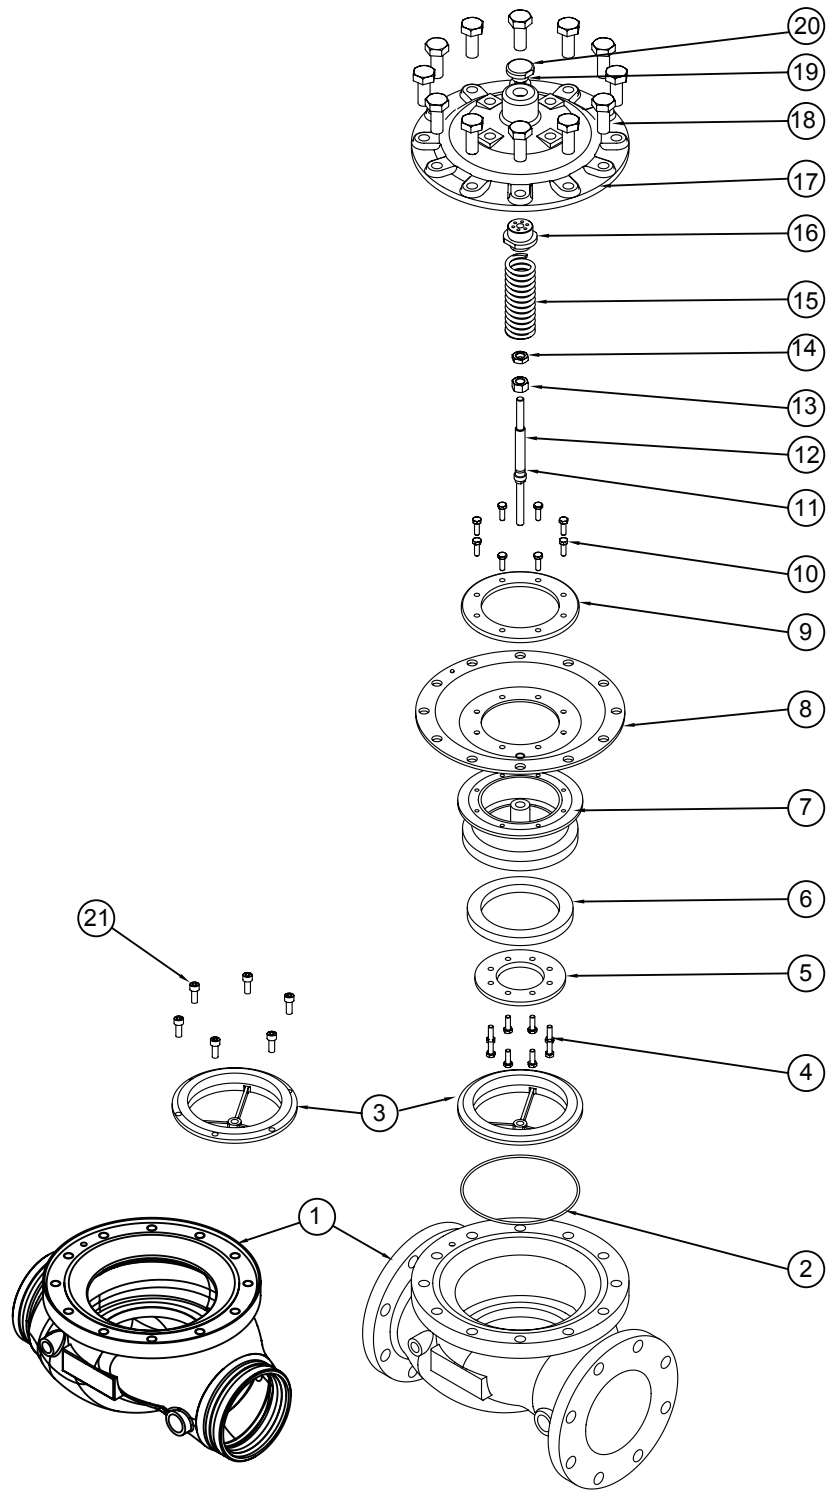

Groove X Groove

Flange to Flange

DELUGE VALVE MODEL - SD-DVH3

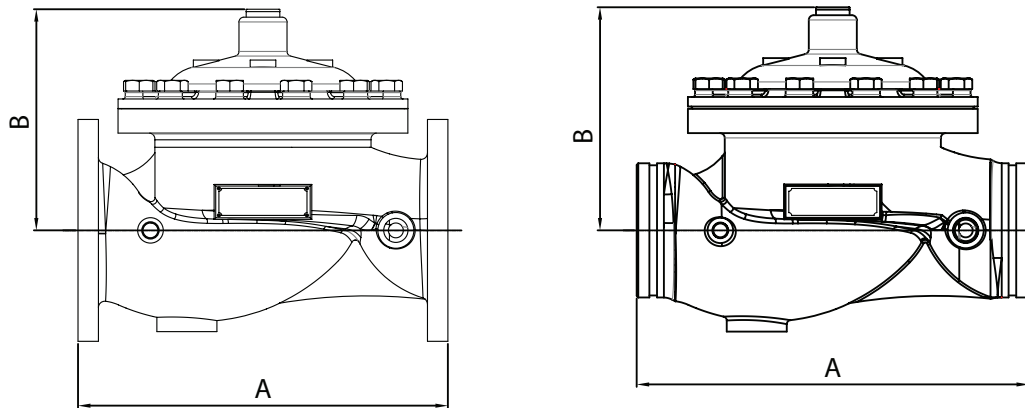

DIMENSION in millimeter (Approximate)

VALVE NOMINAL SIZE	A		B
	F x F	G x G	
200 NB	552	580	332
150 NB	462	490	282
100 NB	412	440	245
80 NB	372	400	232
50 NB	320	350	232

ITEM NO.	PART NO.					DESCRIPTION	QTY				MATERIAL SPECIFICATION
	200 NB	150 NB	100 NB	80 NB	50 NB		200 NB	150 NB	100 NB	80/50 NB	
1	NA	NA	NA	NA	NA	HOUSING	1	1	1	1	DUCTILE IRON
2	8561	9783	9784	9791	9791	"O" RING	1	1	1	1	NEOPRENE RUBBER
3	3937	3936	3935	3934	3934	SEAT	1	1	1	1	STAINLESS STEEL *
4	9151	9112	9112	-	-	BOLT	8	4	4	-	STAINLESS STEEL
5	3546	3545	3544	3543	3543	RUBBER CLAMP	1	1	1	1	DUCTILE IRON **
6	4027	4000	4005	4023	4023	RUBBER SEAT	1	1	1	1	EPDM ***
7	4034	3990	4011	4041	4041	CLAPPER	1	1	1	1	DUCTILE IRON **
8	4035	2427	2507	2786	2786	DIAPHRAGM	1	1	1	1	EPDM ***
9	3542	3541	3540	3539	3539	CLAMP RING	1	1	1	1	DUCTILE IRON **
10	8806	9151	9151	9151	9151	BOLT	12	8	8	8	STAINLESS STEEL
11	114221	114221	114221	114221	114221	"O" RING	1	1	1	1	NEOPRENE RUBBER
12	4029	3996	4007	4020	4020	SPINDLE	1	1	1	1	STAINLESS STEEL
13	8838	8838	8838	8838	8838	NUT	1	1	1	1	STAINLESS STEEL
14	9184	9184	9184	9184	9184	LOCK NUT	1	1	1	1	STAINLESS STEEL
15	2980	2979	2978	2977	2977	SPRING	1	1	1	1	STAINLESS STEEL
16	4033	3998	4010	3983	3983	ADAPTOR	1	1	1	1	BRASS
17	NA	NA	NA	NA	NA	COVER	1	1	1	1	DUCTILE IRON
18	9008	9049	9051	9027	9027	BOLT	16	12	12	12	CARBON STEEL
19	9982	9982	9982	9982	9982	"O" RING	1	1	1	1	NEOPRENE RUBBER
20	2514	2514	2514	2514	2514	PLUG	1	1	1	1	STEEL PLATED
21	8843	-	-	-	-	ALLEN BOLT	6	-	-	-	STAINLESS STEEL

* Stainless Steel is standard supply, Bronze is optional supply.


** Ductile Iron is standard supply, Bronze/Stainless Steel is optional supply.

*** EPDM is standard supply with Stainless Steel Seat, Neoprene is optional supply with Stainless Steel & Bronze Seat.

NA - PART REPLACEMENT NOT AVAILABLE

SCHEMATIC FOR WET PILOT BASIC FOR VERTICAL MOUNTING


SH3-TW

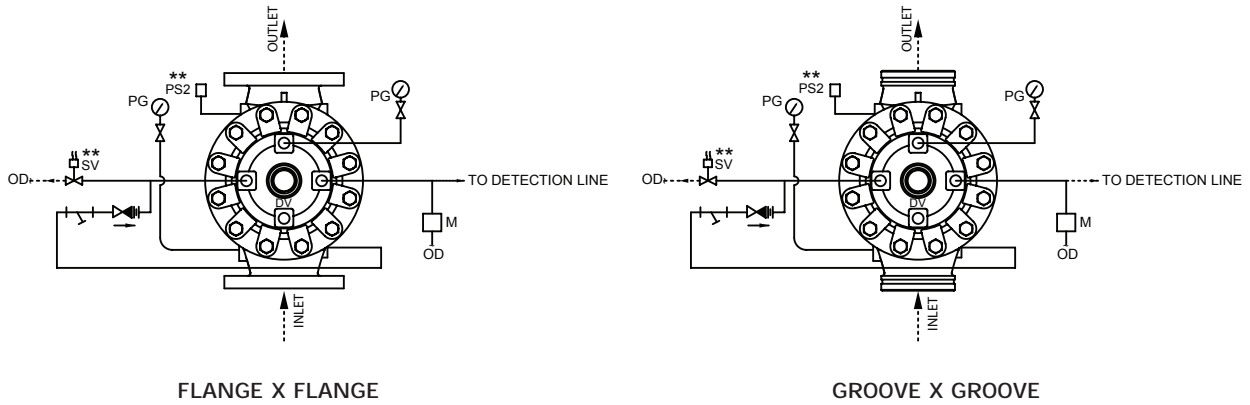

SCHEMATIC 1

SCHEMATIC FOR DRY PILOT BASIC TRIM FOR VERTICAL MOUNTING

SH3-TD

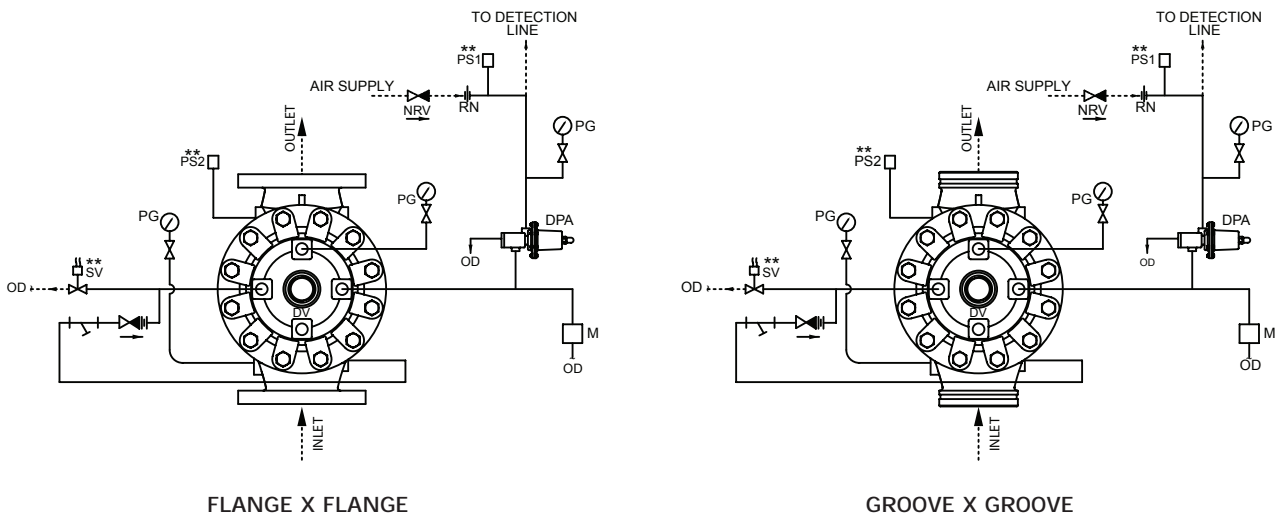

SCHEMATIC 2



DV Deluge Valve
SV Solenoid Valve
G Sprinkler Alarm (WMG)
M Emergency Release Station
RN Restriction Nozzle (Priming Line)
PS1 Low Air Alarm Pressure Switch
PS2 Waterflow Pressure Alarm Switch

Valve
By User
Optional
Strainer
OD Open Drain
PG Pressure Gauge

Swing Check Valve
Angle Valve
DPA Dry Pilot Actuator
RN-A Restriction Nozzle (Air Line)
SCV Swing Check Valve

SCHEMATIC FOR WET PILOT BASIC TRIM WITH TEST AND ALARM TRIM FOR VERTICAL MOUNTING



SH3-TWT

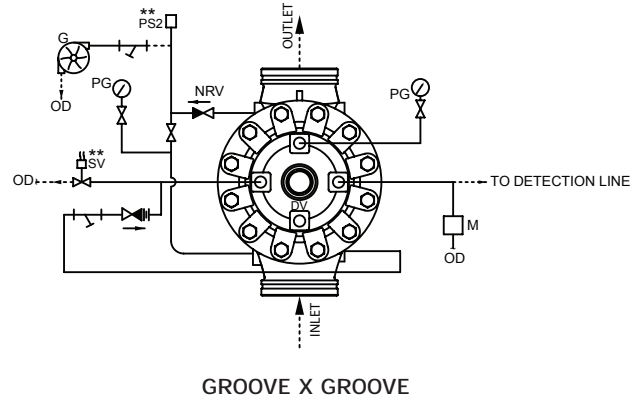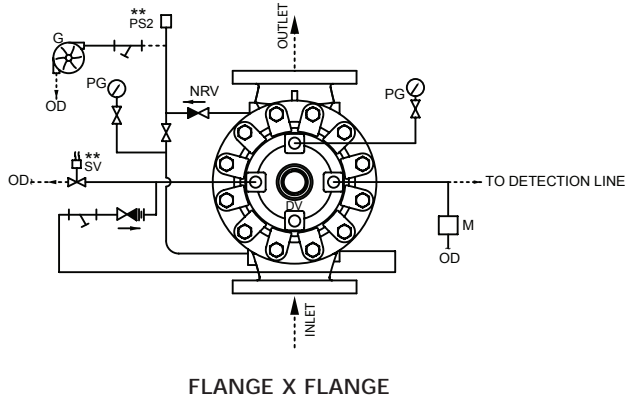

SCHEMATIC 3

SCHEMATIC FOR DRY PILOT BASIC TRIM WITH TEST AND ALARM TRIM FOR VERTICAL MOUNTING

SH3-TDT

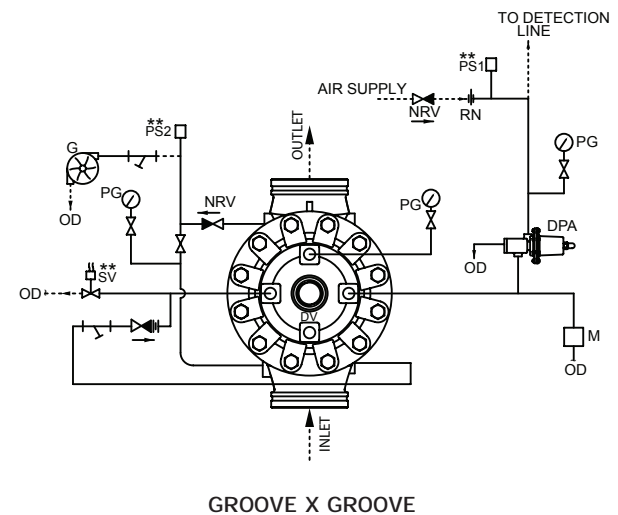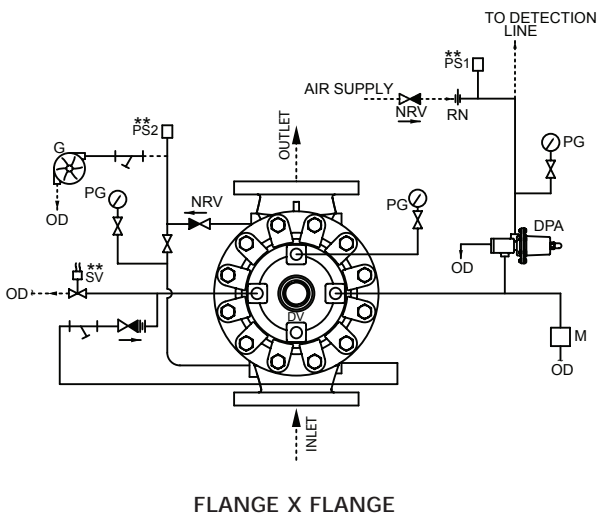

SCHEMATIC 4


DV	Deluge Valve
SV	Solenoid Valve
G	Sprinkler Alarm (WMG)
M	Emergency Release Station
RN	Restriction Nozzle (Priming Line)
PS1	Low Air Alarm Pressure Switch
PS2	Waterflow Pressure Alarm Switch

∇	Valve
---	By User
**	Optional
⌋	Strainer
OD	Open Drain
PG	Pressure Gauge


↗	Swing Check Valve
⌋	Angle Valve
DPA	Dry Pilot Actuator
RN-A	Restriction Nozzle (Air Line)
SCV	Swing Check Valve

SCHEMATIC FOR WET PILOT BASIC TRIM WITH DRIP AND DRAIN TRIM FOR VERTICAL MOUNTING

SH3-TWD

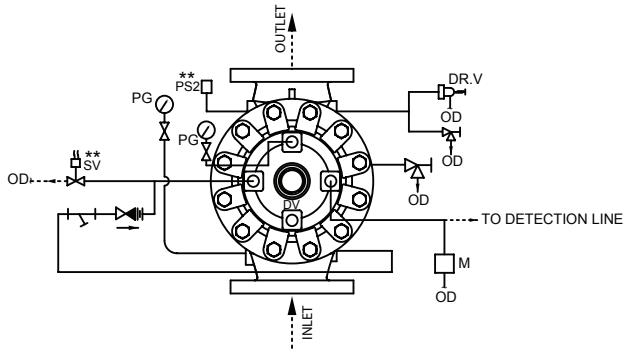

FLANGE X FLANGE

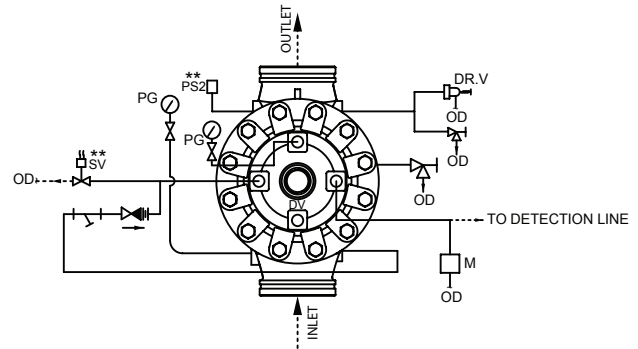


GROOVE X GROOVE


SCHEMATIC 5

SCHEMATIC FOR DRY PILOT BASIC TRIM WITH DRIP AND DRAIN TRIM FOR VERTICAL MOUNTING

SH3-TDD

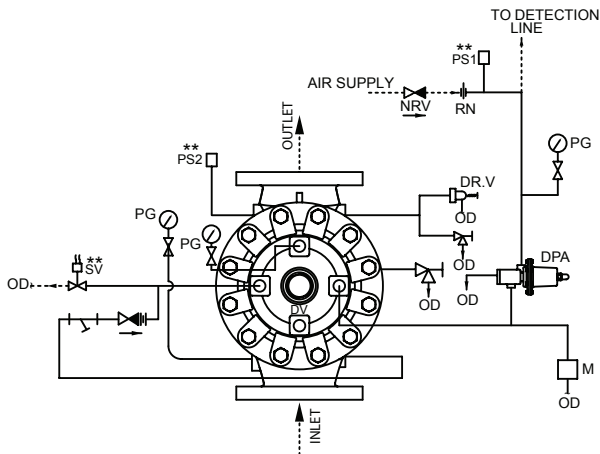

FLANGE X FLANGE

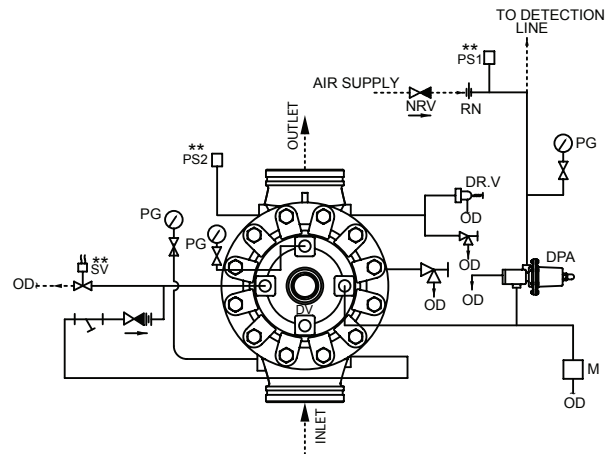

GROOVE X GROOVE


SCHEMATIC 6

DV	Deluge Valve
SV	Solenoid Valve
G	Sprinkler Alarm (WMG)
M	Emergency Release Station
RN	Restriction Nozzle (Priming Line)
PS1	Low Air Alarm Pressure Switch
PS2	Waterflow Pressure Alarm Switch

⋈	Valve
---	By User
**	Optional
⋈	Strainer
OD	Open Drain
PG	Pressure Gauge


⋈	Swing Check Valve
⋈	Angle Valve
DPA	Dry Pilot Actuator
RN-A	Restriction Nozzle (Air Line)
SCV	Swing Check Valve

SCHEMATIC FOR WET PILOT BASIC TRIM WITH TEST AND ALARM TRIM & DRIP AND DRAIN TRIM FOR VERTICAL MOUNTING

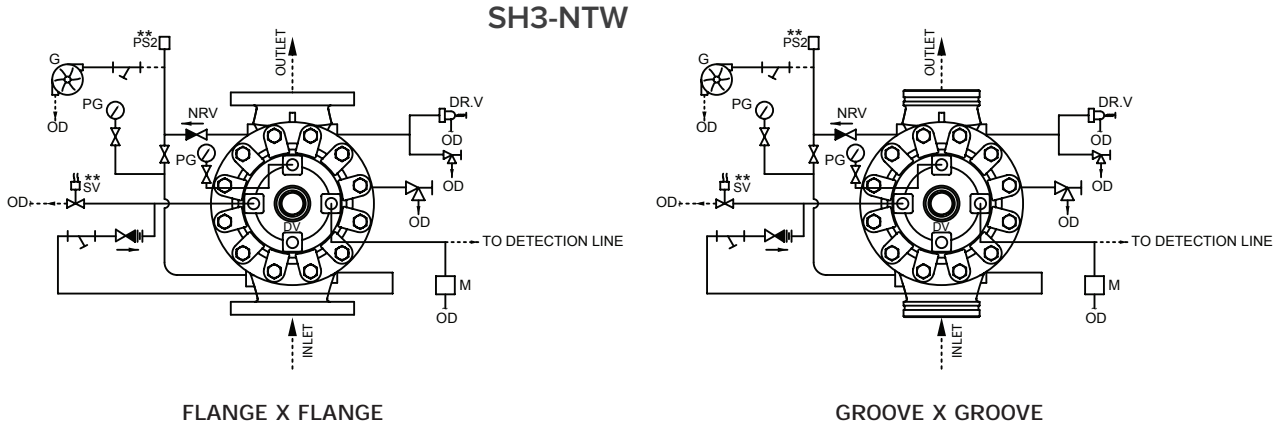

SCHEMATIC 7

SCHEMATIC FOR DRY PILOT BASIC TRIM WITH TEST AND ALARM TRIM & DRIP AND DRAIN TRIM FOR VERTICAL MOUNTING

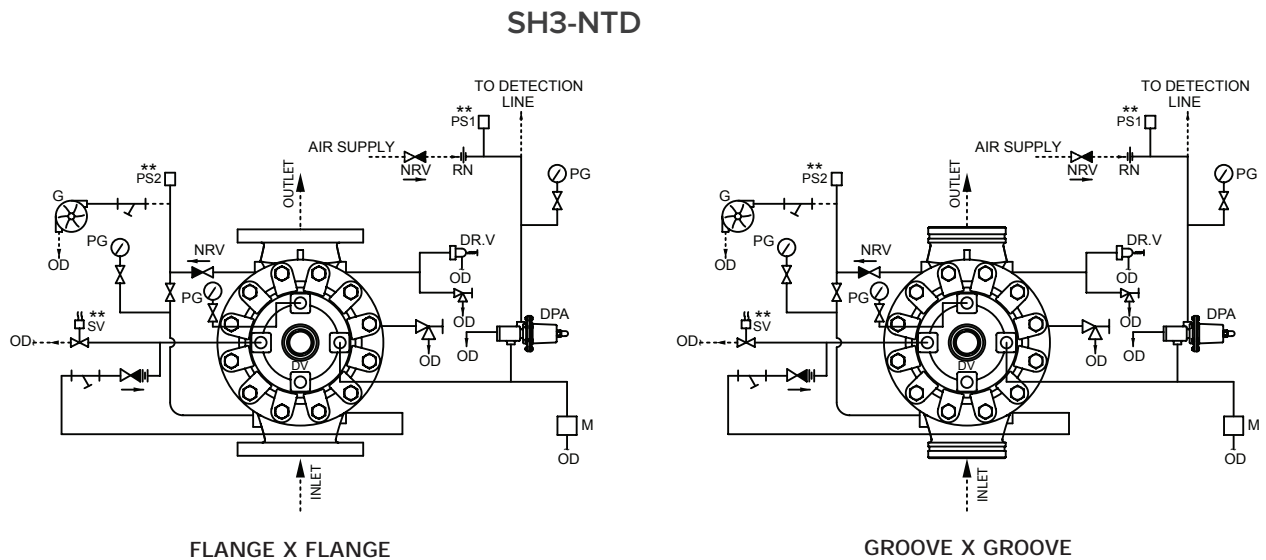

SCHEMATIC 8



DV	Deluge Valve
SV	Solenoid Valve
G	Sprinkler Alarm (WMG)
M	Emergency Release Station
RN	Restriction Nozzle (Priming Line)
PS1	Low Air Alarm Pressure Switch
PS2	Waterflow Pressure Alarm Switch

	Valve
---	By User
**	Optional
	Strainer
OD	Open Drain
PG	Pressure Gauge

	Swing Check Valve
	Angle Valve
DPA	Dry Pilot Actuator
RN-A	Restriction Nozzle (Air Line)
SCV	Swing Check Valve

SCHEMATIC FOR WET PILOT BASIC TRIM FOR HORIZONTAL MOUNTING



SH3-TW

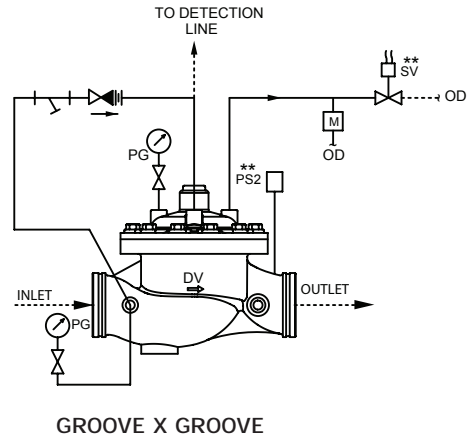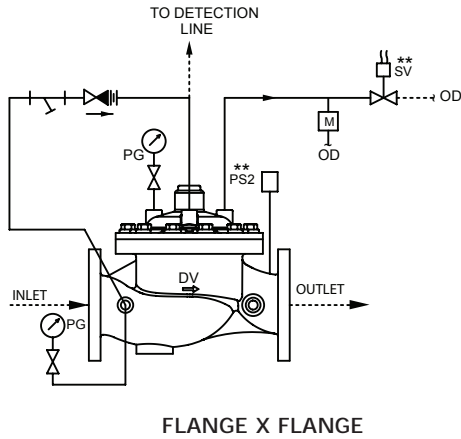

SCHEMATIC 9

SCHEMATIC FOR DRY PILOT BASIC TRIM FOR HORIZONTAL MOUNTING

SH3-TD

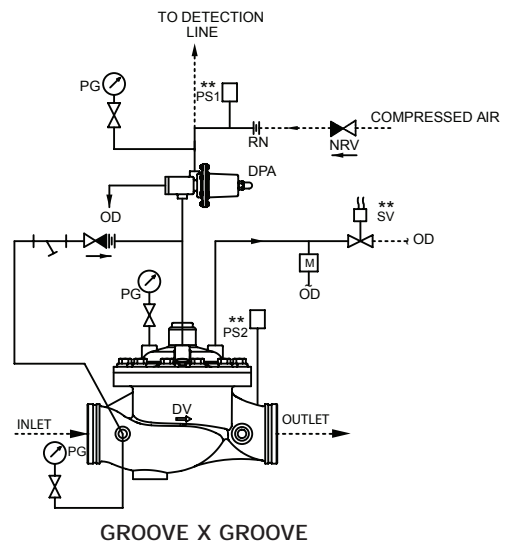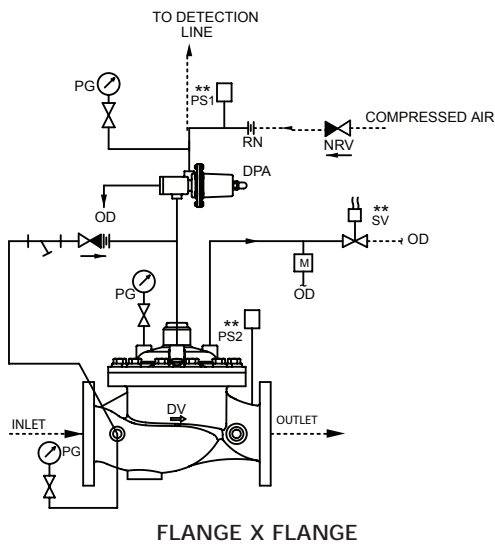


SCHEMATIC 10

DV	Deluge Valve
SV	Solenoid Valve
G	Sprinkler Alarm (WMG)
M	Emergency Release Station
RN	Restriction Nozzle (Priming Line)
PS1	Low Air Alarm Pressure Switch
PS2	Waterflow Pressure Alarm Switch


∇	Valve
---	By User
**	Optional
⌊	Strainer
OD	Open Drain
PG	Pressure Gauge

↗	Swing Check Valve
⌋	Angle Valve
DPA	Dry Pilot Actuator
RN-A	Restriction Nozzle (Air Line)
SCV	Swing Check Valve

SCHEMATIC FOR WET PILOT BASIC TRIM WITH DRIP AND DRAIN TRIM FOR HORIZONTAL MOUNTING

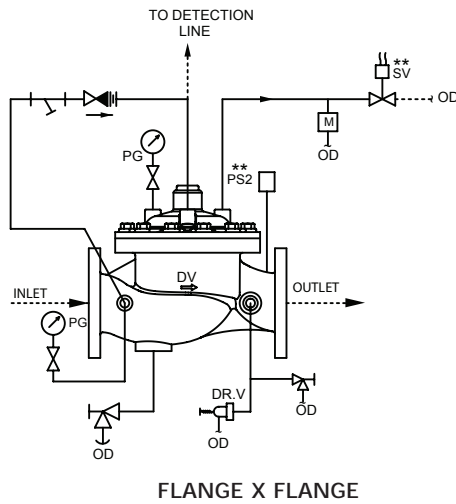


SH3-TWD

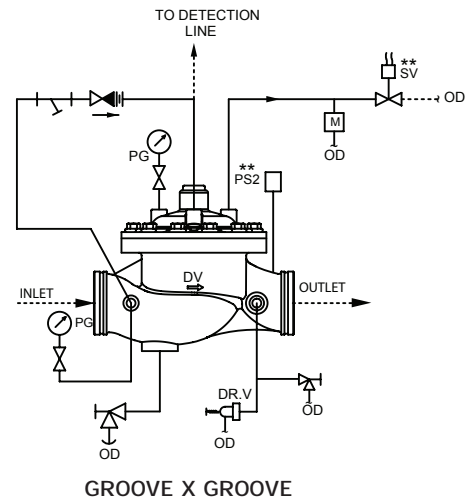


SCHEMATIC 13

SCHEMATIC FOR DRY PILOT BASIC TRIM WITH DRIP AND DRAIN TRIM FOR HORIZONTAL MOUNTING

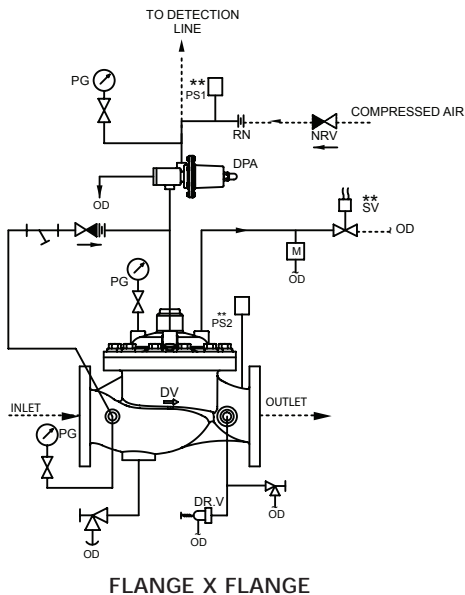

SH3-TDD

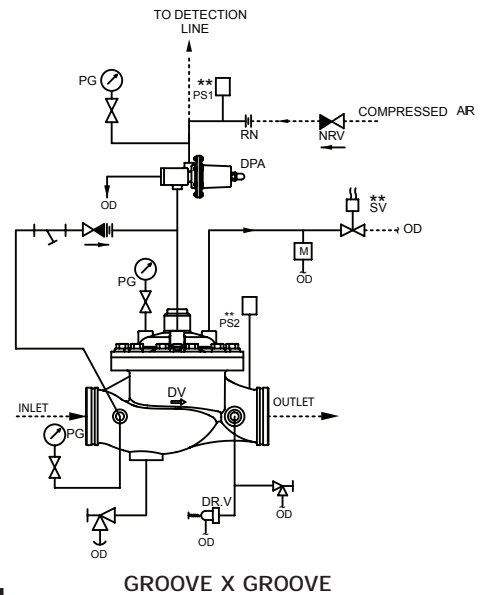

SCHEMATIC 14


DV	Deluge Valve
SV	Solenoid Valve
G	Sprinkler Alarm (WMG)
M	Emergency Release Station
RN	Restriction Nozzle (Priming Line)
PS1	Low Air Alarm Pressure Switch
PS2	Waterflow Pressure Alarm Switch

∇	Valve
---	By User
**	Optional
⌊	Strainer
OD	Open Drain
PG	Pressure Gauge


↗	Swing Check Valve
⌋	Angle Valve
DPA	Dry Pilot Actuator
RN-A	Restriction Nozzle (Air Line)
SCV	Swing Check Valve

SCHEMATIC FOR WET PILOT BASIC TRIM WITH TEST AND ALARM TRIM & DRIP AND DRAIN TRIM FOR HORIZONTAL MOUNTING

SH3-NTW

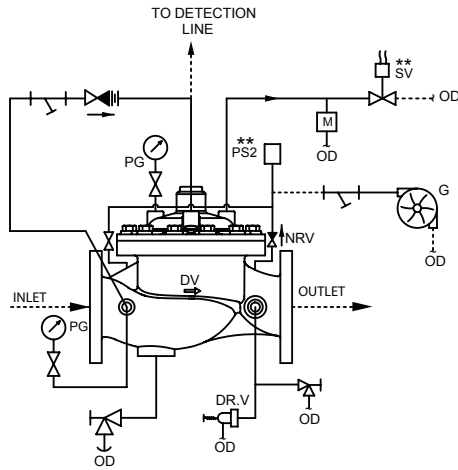

FLANGE X FLANGE

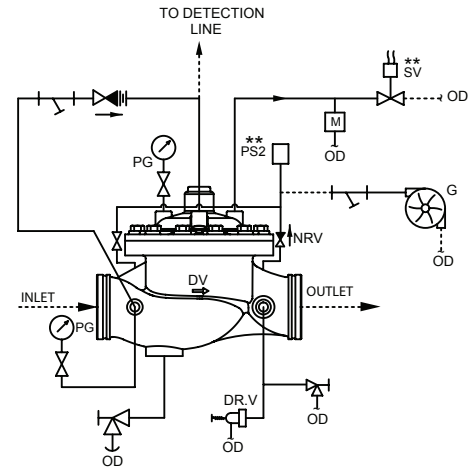


GROOVE X GROOVE


SCHEMATIC 15

SCHEMATIC FOR DRY PILOT BASIC TRIM WITH TEST AND ALARM TRIM & DRIP AND DRAIN TRIM FOR HORIZONTAL MOUNTING

SH3-NTD

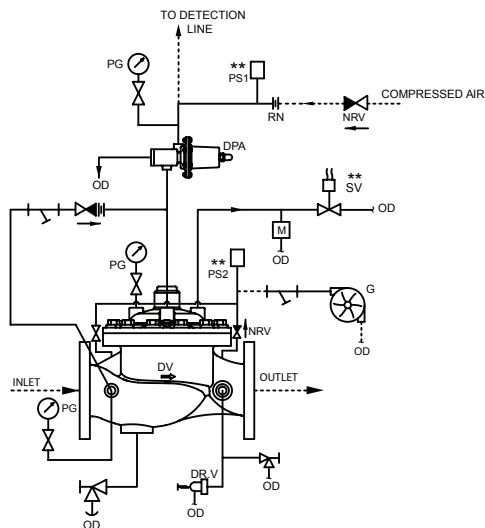

FLANGE X FLANGE

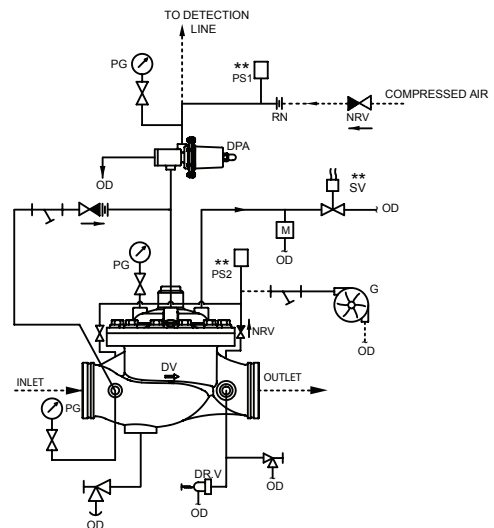

GROOVE X GROOVE

SCHEMATIC 16


DV	Deluge Valve
SV	Solenoid Valve
G	Sprinkler Alarm (WMG)
M	Emergency Release Station
RN	Restriction Nozzle (Priming Line)
PS1	Low Air Alarm Pressure Switch
PS2	Waterflow Pressure Alarm Switch

⋈	Valve
---	By User
**	Optional
⋈	Strainer
OD	Open Drain
PG	Pressure Gauge


⋈	Swing Check Valve
⋈	Angle Valve
DPA	Dry Pilot Actuator
RN-A	Restriction Nozzle (Air Line)
SCV	Swing Check Valve

SPRINKLER HEIGHT LIMITATION


DV 200NB

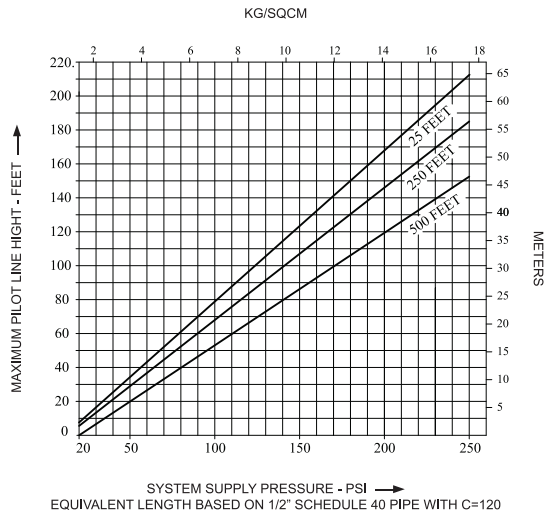


DV 150NB

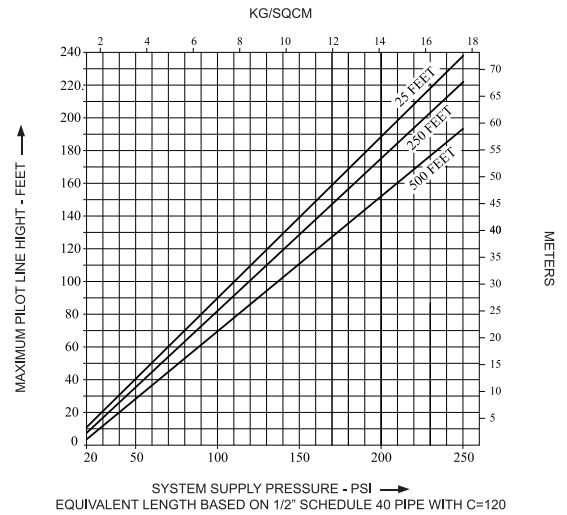


DV 100NB

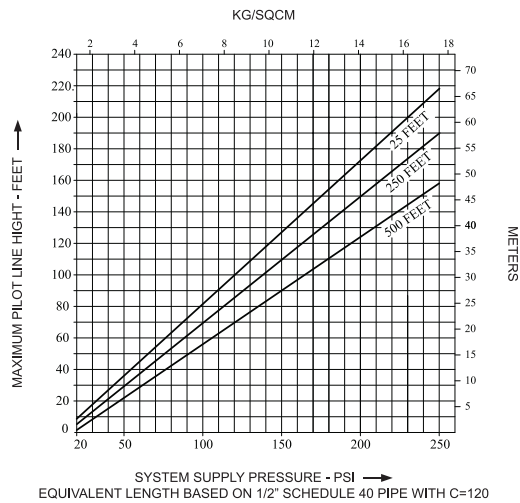

DV 80NB

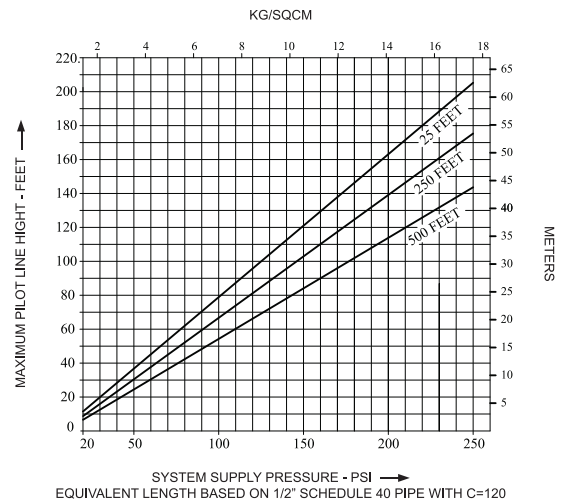


DV - 50NB

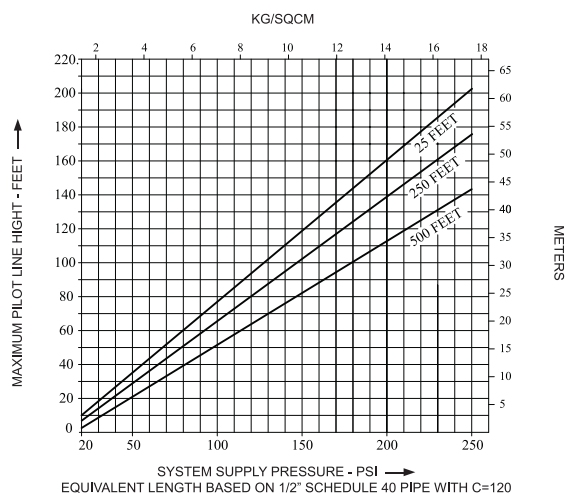

NOMINAL PRESSURE LOSS VS FLOW

(* Flow at 15 feet per second [4.57 meter per second])

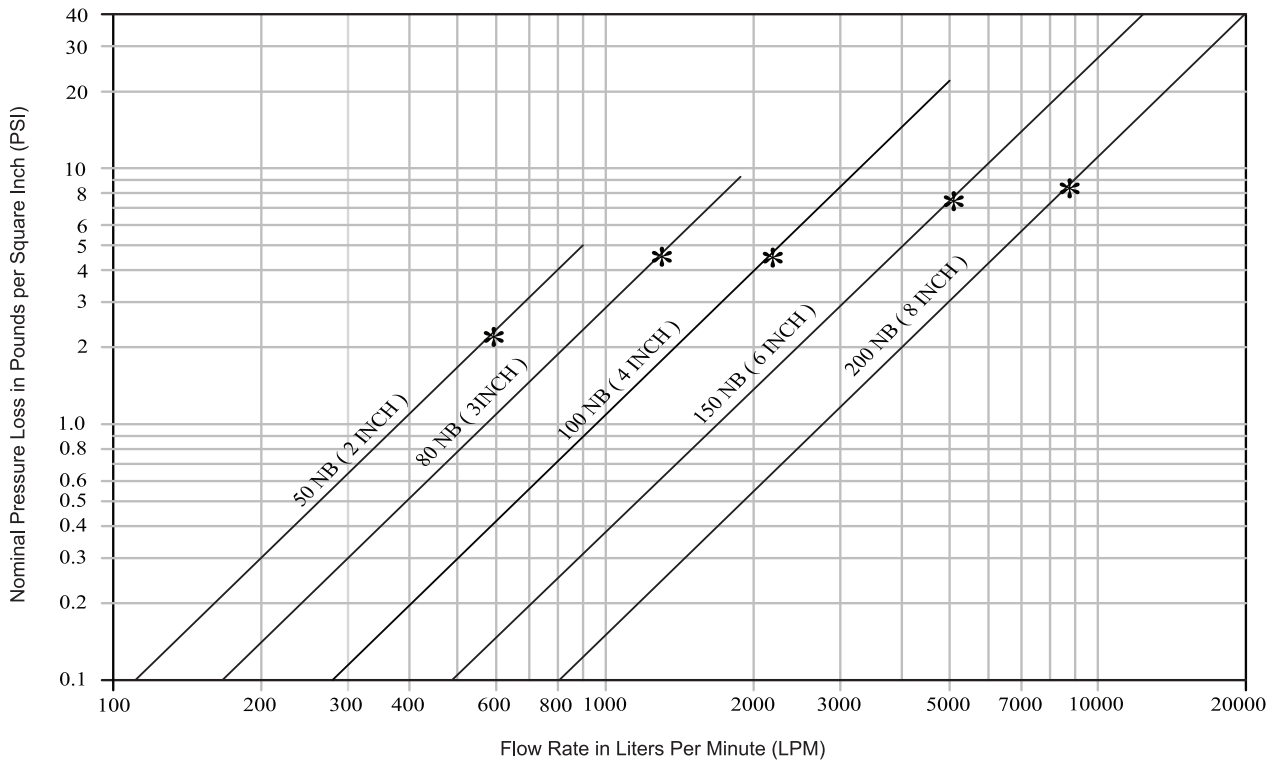

- * 2.3 PSI Pressure loss @ 15 feet per second (4.57 met/sec) velocity having flow of 594 LPM thru 50NB DV
- * 4.7 PSI Pressure loss @ 15 feet per second (4.57 met/sec) velocity having flow of 1308 LPM thru 80NB DV
- * 4.7 PSI Pressure loss @ 15 feet per second (4.57 met/sec) velocity having flow of 2255 LPM thru 100NB DV
- * 7.5 PSI Pressure loss @ 15 feet per second (4.57 met/sec) velocity having flow of 5117 LPM thru 150NB DV
- * 8.4 PSI Pressure loss @ 15 feet per second (4.57 met/sec) velocity having flow of 8854 LPM thru 200NB DV